


Appendix 1 A-1

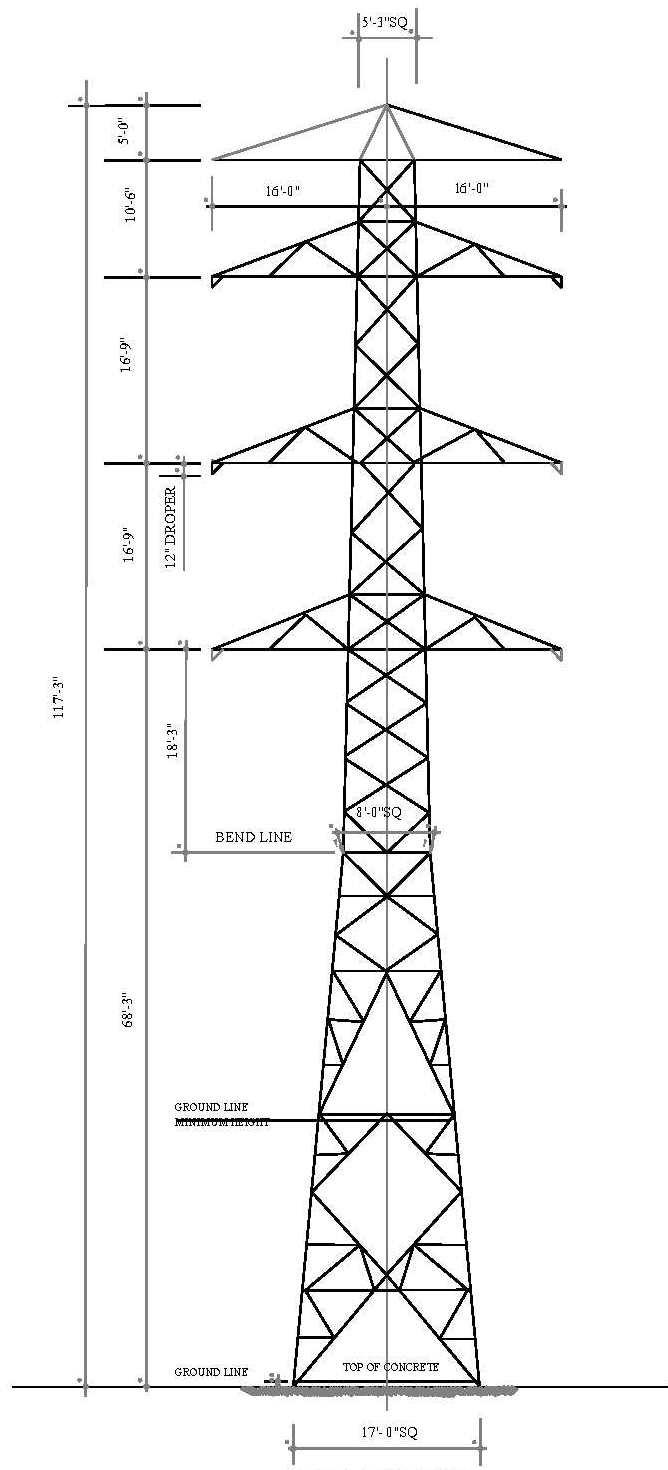

STANDARD HEIGHT  
G/A OF 132KV STEEL TOWER  
SUSPENSION TOWER


	DATE	SIGN
APPROVED		
CHECKED ENGINEER I/C		
CHECKED HEAD D/MAN		
DRAWN		
TRACED		

REF	REVISION	DATE	SIGN


TITLE
GENERAL ARRANGEMENT OF TOWER

APPENDIX 1.A.1

Appendix 1 A-2

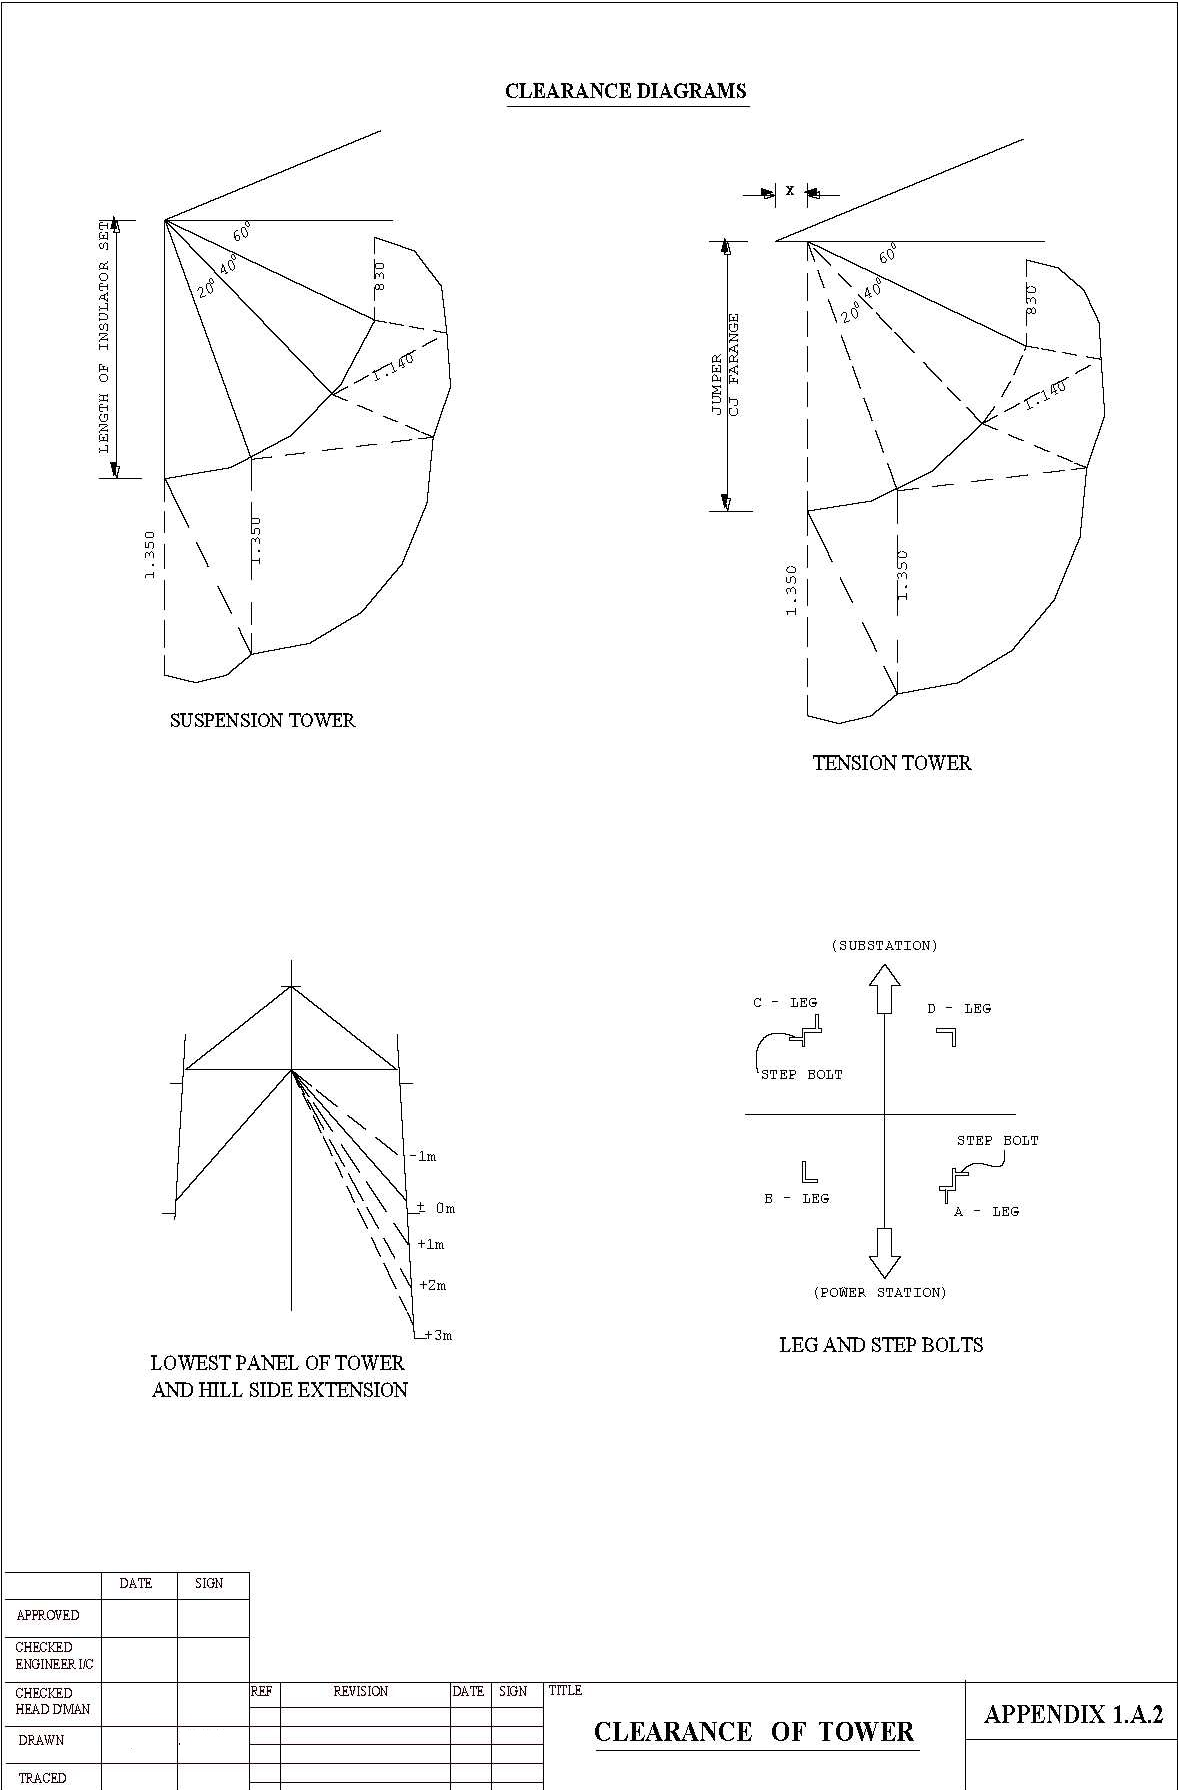

## Appendix 1 A-3

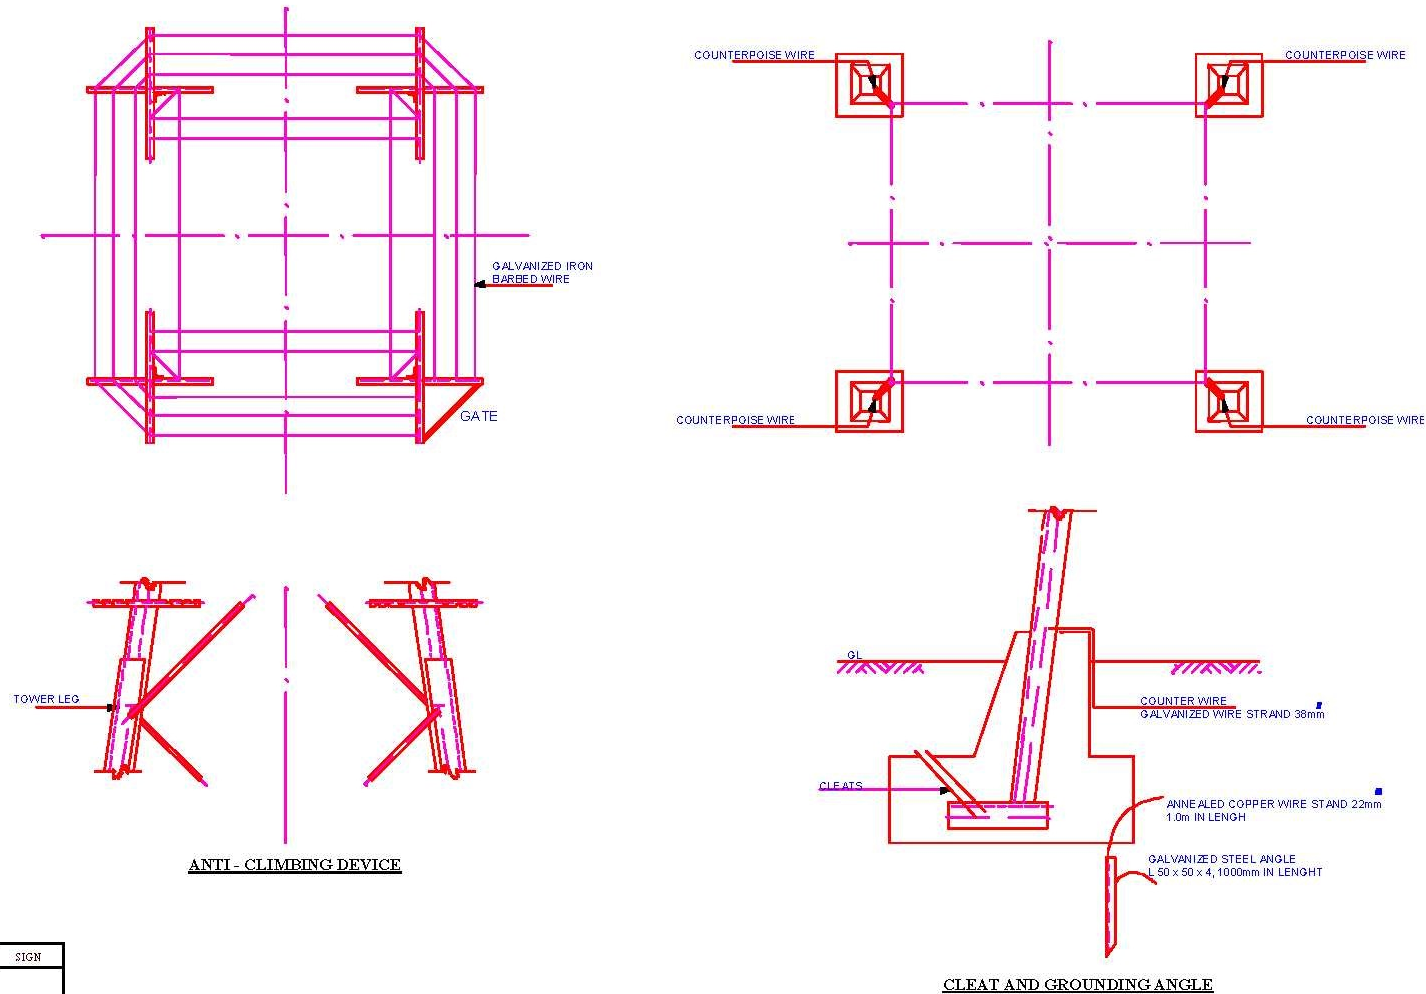

	DATE	SIGN
APPROVED		
CHECKED ENGINEER U/C		
CHECKED HEAD D'MAN		
DRAWN		
TRACED		

REF	REVISION	DATE	SIGN	TITLE

### ANTI - CLIMBING DEVICE AND GROUNDING SYSTEM

APPENDIX 1.A.3

**Appendix 1.A.4**

