



KAWI Complex • Block B  
 Popo Lane, off Red Cross Road, South C  
 P. O. Box 34942 – 00100, NAIROBI  
 Phone: 020 4956000, 0719018000, 0732128000  
 Web: www.ketraco.co.ke • email: info@ketraco.co.ke

**ADDENDUM NO. 2**

Our ref: KETRACO/PT/024/2025-2026

28TH MAY 2026

Notice to all Bidders.

**RE: TENDER FOR SUPPLY OF COOPER POWER SYSTEMS SINGLE PHASE CAPACITOR MODULES'. (TENDER NUMBER: KETRACO/PT/024/2025-2026)**

The following amendments are made to the specified provisions of the TENDER FOR SUPPLY OF COOPER POWER SYSTEMS SINGLE PHASE CAPACITOR MODULES'. (TENDER NUMBER: KETRACO/PT/024/2025-2026). Save where expressly amended by the terms of this addendum, the Principal Tender Document shall continue to be in full force and effect. Find herein the ADDENDUM, AND CLARIFICATIONS consisting of one (2) pages into the Principal Tender Documents.

*Tender Addendum and clarification NO 2*

NO	SUPPLIER CLARIFICATION	KETRACO RESPONSE
1	Technical details of capacitor	Refer Clause 4.3.8 Technical specification-Reference document Attached
2	Datasheet	Capacitor modules datasheet, attached

All other terms and conditions of the tender remain the same. Any tender inquiries should be sent to [kettenders@ketraco.co.ke](mailto:kettenders@ketraco.co.ke)

**SENIOR MANAGER SUPPLY CHAIN MANAGEMENT**

Tender Addendum No. 1 of Tender No. KETRACO/PT/024/2025-2026 has been received and incorporated in the Tender Documents.

Name of Tenderer (*in block letters*):

\_\_\_\_\_

Signature:

\_\_\_\_\_

Date:

---


Signed for the Tenderer by  
*(Name in block letters):*

---

In the office bearer capacity  
of:

---

---

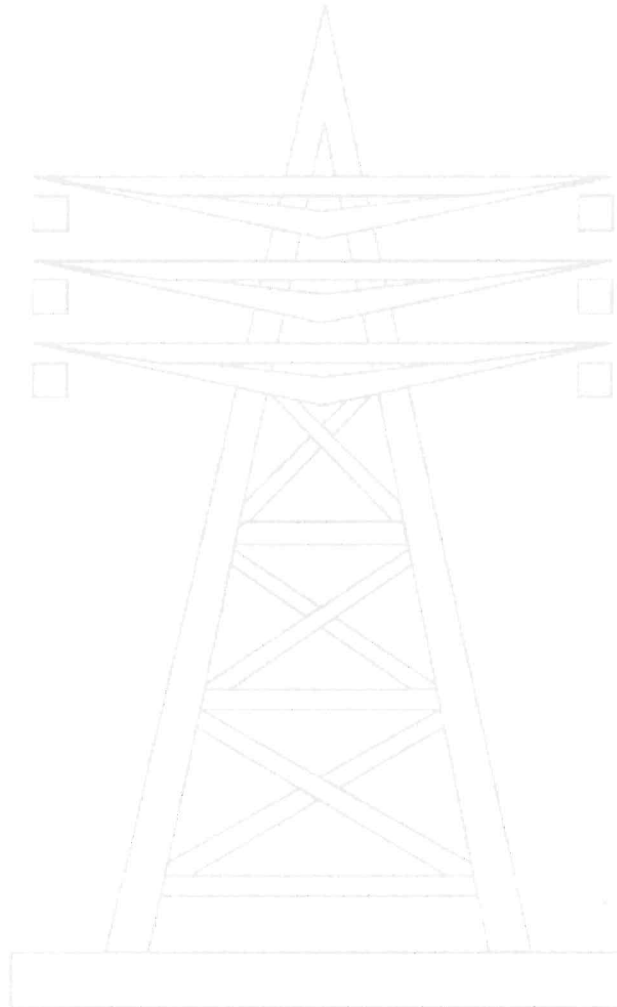

APPENDIX I



COOPER POWER SYSTEMS

### CAPACITOR BANK DATA SHEET

Customer: SIEMENS KENYA

Date: 4/5/2013

City:

State/ Country: KENYA

Customer Order #: 4509235565

CPS Order Number: 204084139

Substation: TURKANA HV - SUSWA

#### BANK DATA

Capacitor Equipment Part Number: CEB13016F1208F1

kVAr Rated: 40175                      kV Rated L-L: 245

kVAr Operated:                              kV Operated L-L:

kVAr Future (Rated):

kVAr Future (Operated):

Bank Connection: single grounded wye

Bank kV BIL: 1050

Number of Series Groups: 8              Number of Parallel Units: 3

No. of Blocks: 12

Installed Units in Block: 6

Future Units in Block: 8

#### CAPACITOR UNIT DATA

	<u>MAIN</u>	<u>AUXILIARY</u>
Catalog Number:	CEP13025A1	CEP13026A1
Rated kVAr:	558	167
Rated Voltage:	17682	825
Rated kV BIL:	150	110

#### INDIVIDUAL PROTECTION

	<u>MAIN</u>	<u>AUXILIARY</u>
Indiv. Cap. Fuse:		
Flipper Assembly:		
Cap. Fuse Link:		