




COVER

1

| | | | | | |
|--|---|---|---------------------------------------|--|--|
| REFERENCE DRAWINGS | | | | | |
| DRAWING NO. | TITLE | | | | |
| | | | | | |
| | | | | | |
| | | | | | |
| <input type="checkbox"/> APPROVED | <input type="checkbox"/> APPROVED WITH COMMENTS | | <input type="checkbox"/> NOT APPROVED | | <input type="checkbox"/> FOR INFORMATION |
| DATE: | | SIGNATURE/STAMP..... PROJECT CONSULTANT | | | |
|  KETRACO Kenya Electricity Transmission Company Limited | | | | | |
|  COLENCO <i>Innovative for sustainable future</i> | | | COLENCO CONSULTING LIMITED | | |
| PROJECT: | | | | | |
| KENYA TRANSMISSION NETWORK IMPROVEMENT PROJECT (KTRIMP). | | | | | |
| PROJECT DRAWING NO. | | PROJECT NO. | | | |
| NAME: | NEL | DATE: | | | |
| PREPARED: | FJ | DATE: | RUMURUTI 132/33KV SUBSTATION | | |
| DRAWN: | J.J | 14/05/2025 | TITLE: | | |
| CHECKED: | V JOSHI | 14/05/2025 | 33KV SINGLE LINE DIAGRAM | | |
| APPROVED: | S.DHIRMIRAH | 14/05/2025 | | | |
| REVISIONS | NO. | NAME | DATE | | |
| | | | | | |
| | | | | | |
| | | | | | |
| SCALE: 1:600 | | DWG NO. | RUMURUTI-SLD-33KV-002 | | REV.: |

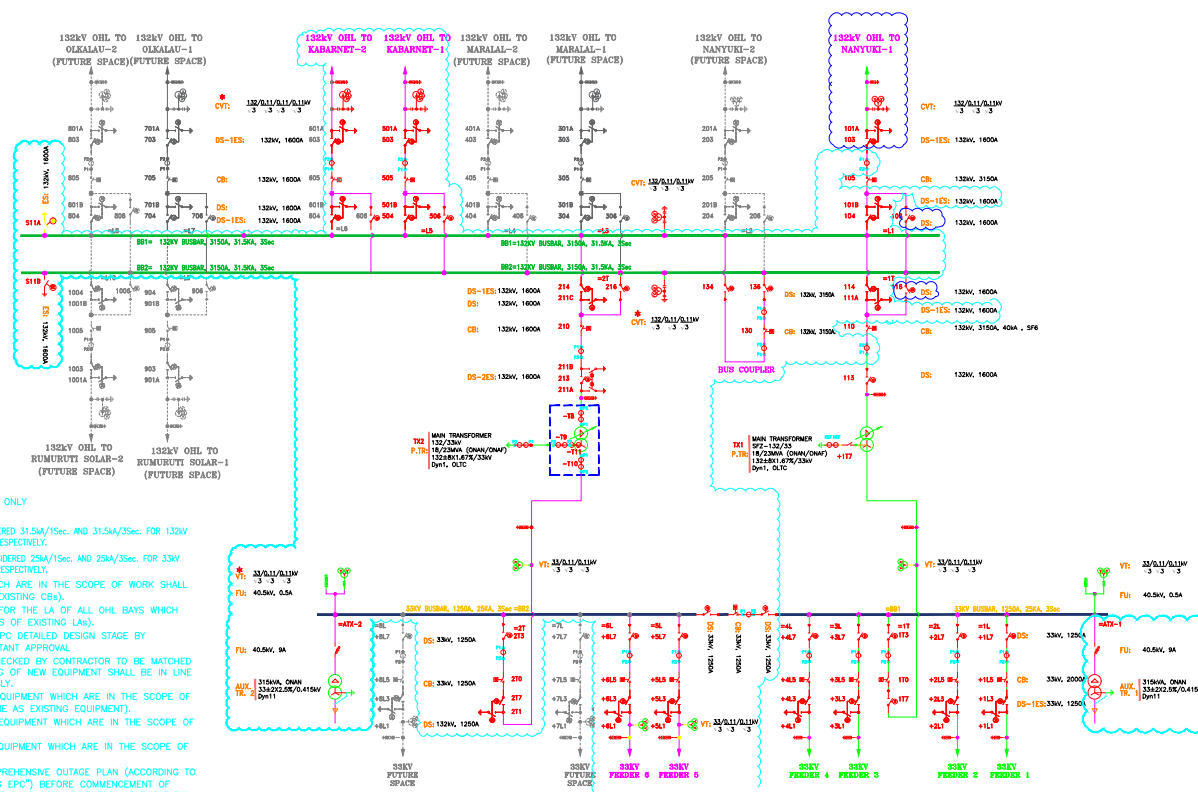

3

[illegible]