





1	2	3	4	5	6	7	8																																																						
A								A																																																					
B								B																																																					
C	<div>KIMUKA (400/220 kV Substation) CHAIN LINK FENCE AND ENTRANCE GATE DRAWING</div>							C																																																					
D								D																																																					
E								E																																																					
F	<div><div><div>PREPARED BY:</div><div><div>موننکو ایران</div><div>Monenco Iran</div><div></div></div></div><table><tr><td></td><td></td><td></td><td></td><td></td><td></td><td>DESIGNED BY</td><td>NVM</td><td>SIGNATURE</td></tr><tr><td></td><td></td><td></td><td></td><td></td><td></td><td>DRAWN BY</td><td>SAT</td><td></td></tr><tr><td>B</td><td>THIRD ISSUE</td><td>NVM</td><td>SAT</td><td>ARG</td><td>JVN</td><td>19.09.2021</td><td>CHECKED BY</td><td>ARG</td></tr><tr><td>A</td><td>SECOND ISSUE</td><td>NVM</td><td>SAT</td><td>ARG</td><td>JVN</td><td>30.05.2021</td><td>APPROVED BY</td><td>JVN</td></tr><tr><td>0</td><td>FIRST ISSUE</td><td>NVM</td><td>SAT</td><td>ARG</td><td>JVN</td><td>03.05.2021</td><td>DATE:</td><td>19.09.2021</td></tr><tr><td>REV</td><td>DESCRIPTION</td><td>DESIGN</td><td>CHK</td><td>HEAD</td><td>APPR.</td><td>DATE</td><td>SCALE:</td><td></td></tr></table></div> <div><div>PROJECT:</div><div>KIMUKA (400/220 kV Substation)</div></div> <div><div>DWG. TITLE:</div><div>CHAIN LINK FENCE AND ENTRANCE GATE DRAWING</div></div> <div><div>CLIENT:</div><div><div>KETRACO Kenya Electricity Transmission Co. Ltd.</div><div>THE WORLD BANK IBRD · IDA · WORLD BANK GROUP</div></div></div> <div><div>DWG. NO.:MT-TLD-KETCO-5393-DD-01-WF-383</div><div>SHEET: 1 OF: 4</div></div>													DESIGNED BY	NVM	SIGNATURE							DRAWN BY	SAT		B	THIRD ISSUE	NVM	SAT	ARG	JVN	19.09.2021	CHECKED BY	ARG	A	SECOND ISSUE	NVM	SAT	ARG	JVN	30.05.2021	APPROVED BY	JVN	0	FIRST ISSUE	NVM	SAT	ARG	JVN	03.05.2021	DATE:	19.09.2021	REV	DESCRIPTION	DESIGN	CHK	HEAD	APPR.	DATE	SCALE:	
						DESIGNED BY	NVM	SIGNATURE																																																					
						DRAWN BY	SAT																																																						
B	THIRD ISSUE	NVM	SAT	ARG	JVN	19.09.2021	CHECKED BY	ARG																																																					
A	SECOND ISSUE	NVM	SAT	ARG	JVN	30.05.2021	APPROVED BY	JVN																																																					
0	FIRST ISSUE	NVM	SAT	ARG	JVN	03.05.2021	DATE:	19.09.2021																																																					
REV	DESCRIPTION	DESIGN	CHK	HEAD	APPR.	DATE	SCALE:																																																						

1	2	3	4	5	6	7	8	
A								A
B								B
C								C
D								D
E								E
F								F

PREPARED BY:

موننکو ایران

Monenco Iran



							DESIGNED BY	NVM	SIGNATURE
							DRAWN BY	SAT	
B	THIRD ISSUE	NVM	SAT	ARG	JVN	19.09.2021	CHECKED BY	ARG	
A	SECOND ISSUE	NVM	SAT	ARG	JVN	30.05.2021	APPROVED BY	JVN	
0	FIRST ISSUE	NVM	SAT	ARG	JVN	03.05.2021	DATE:	19.09.2021	
REV	DESCRIPTION	DESIGN	CHK	HEAD	APPR.	DATE	SCALE:		

PROJECT:


KIMUKA


(400/220 kV Substation)

DWG. TITLE:

CHAIN LINK FENCE AND ENTRANCE GATE DRAWING

CLIENT:

KETRACO

THE WORLD BANK


Kenya Electricity Transmission Co. Ltd.



IBRD · IDA · WORLD BANK GROUP


DWG. NO.:MT-TLD-KETCO-5393-DD-01-WF-383

SHEET: 2 OF: 4

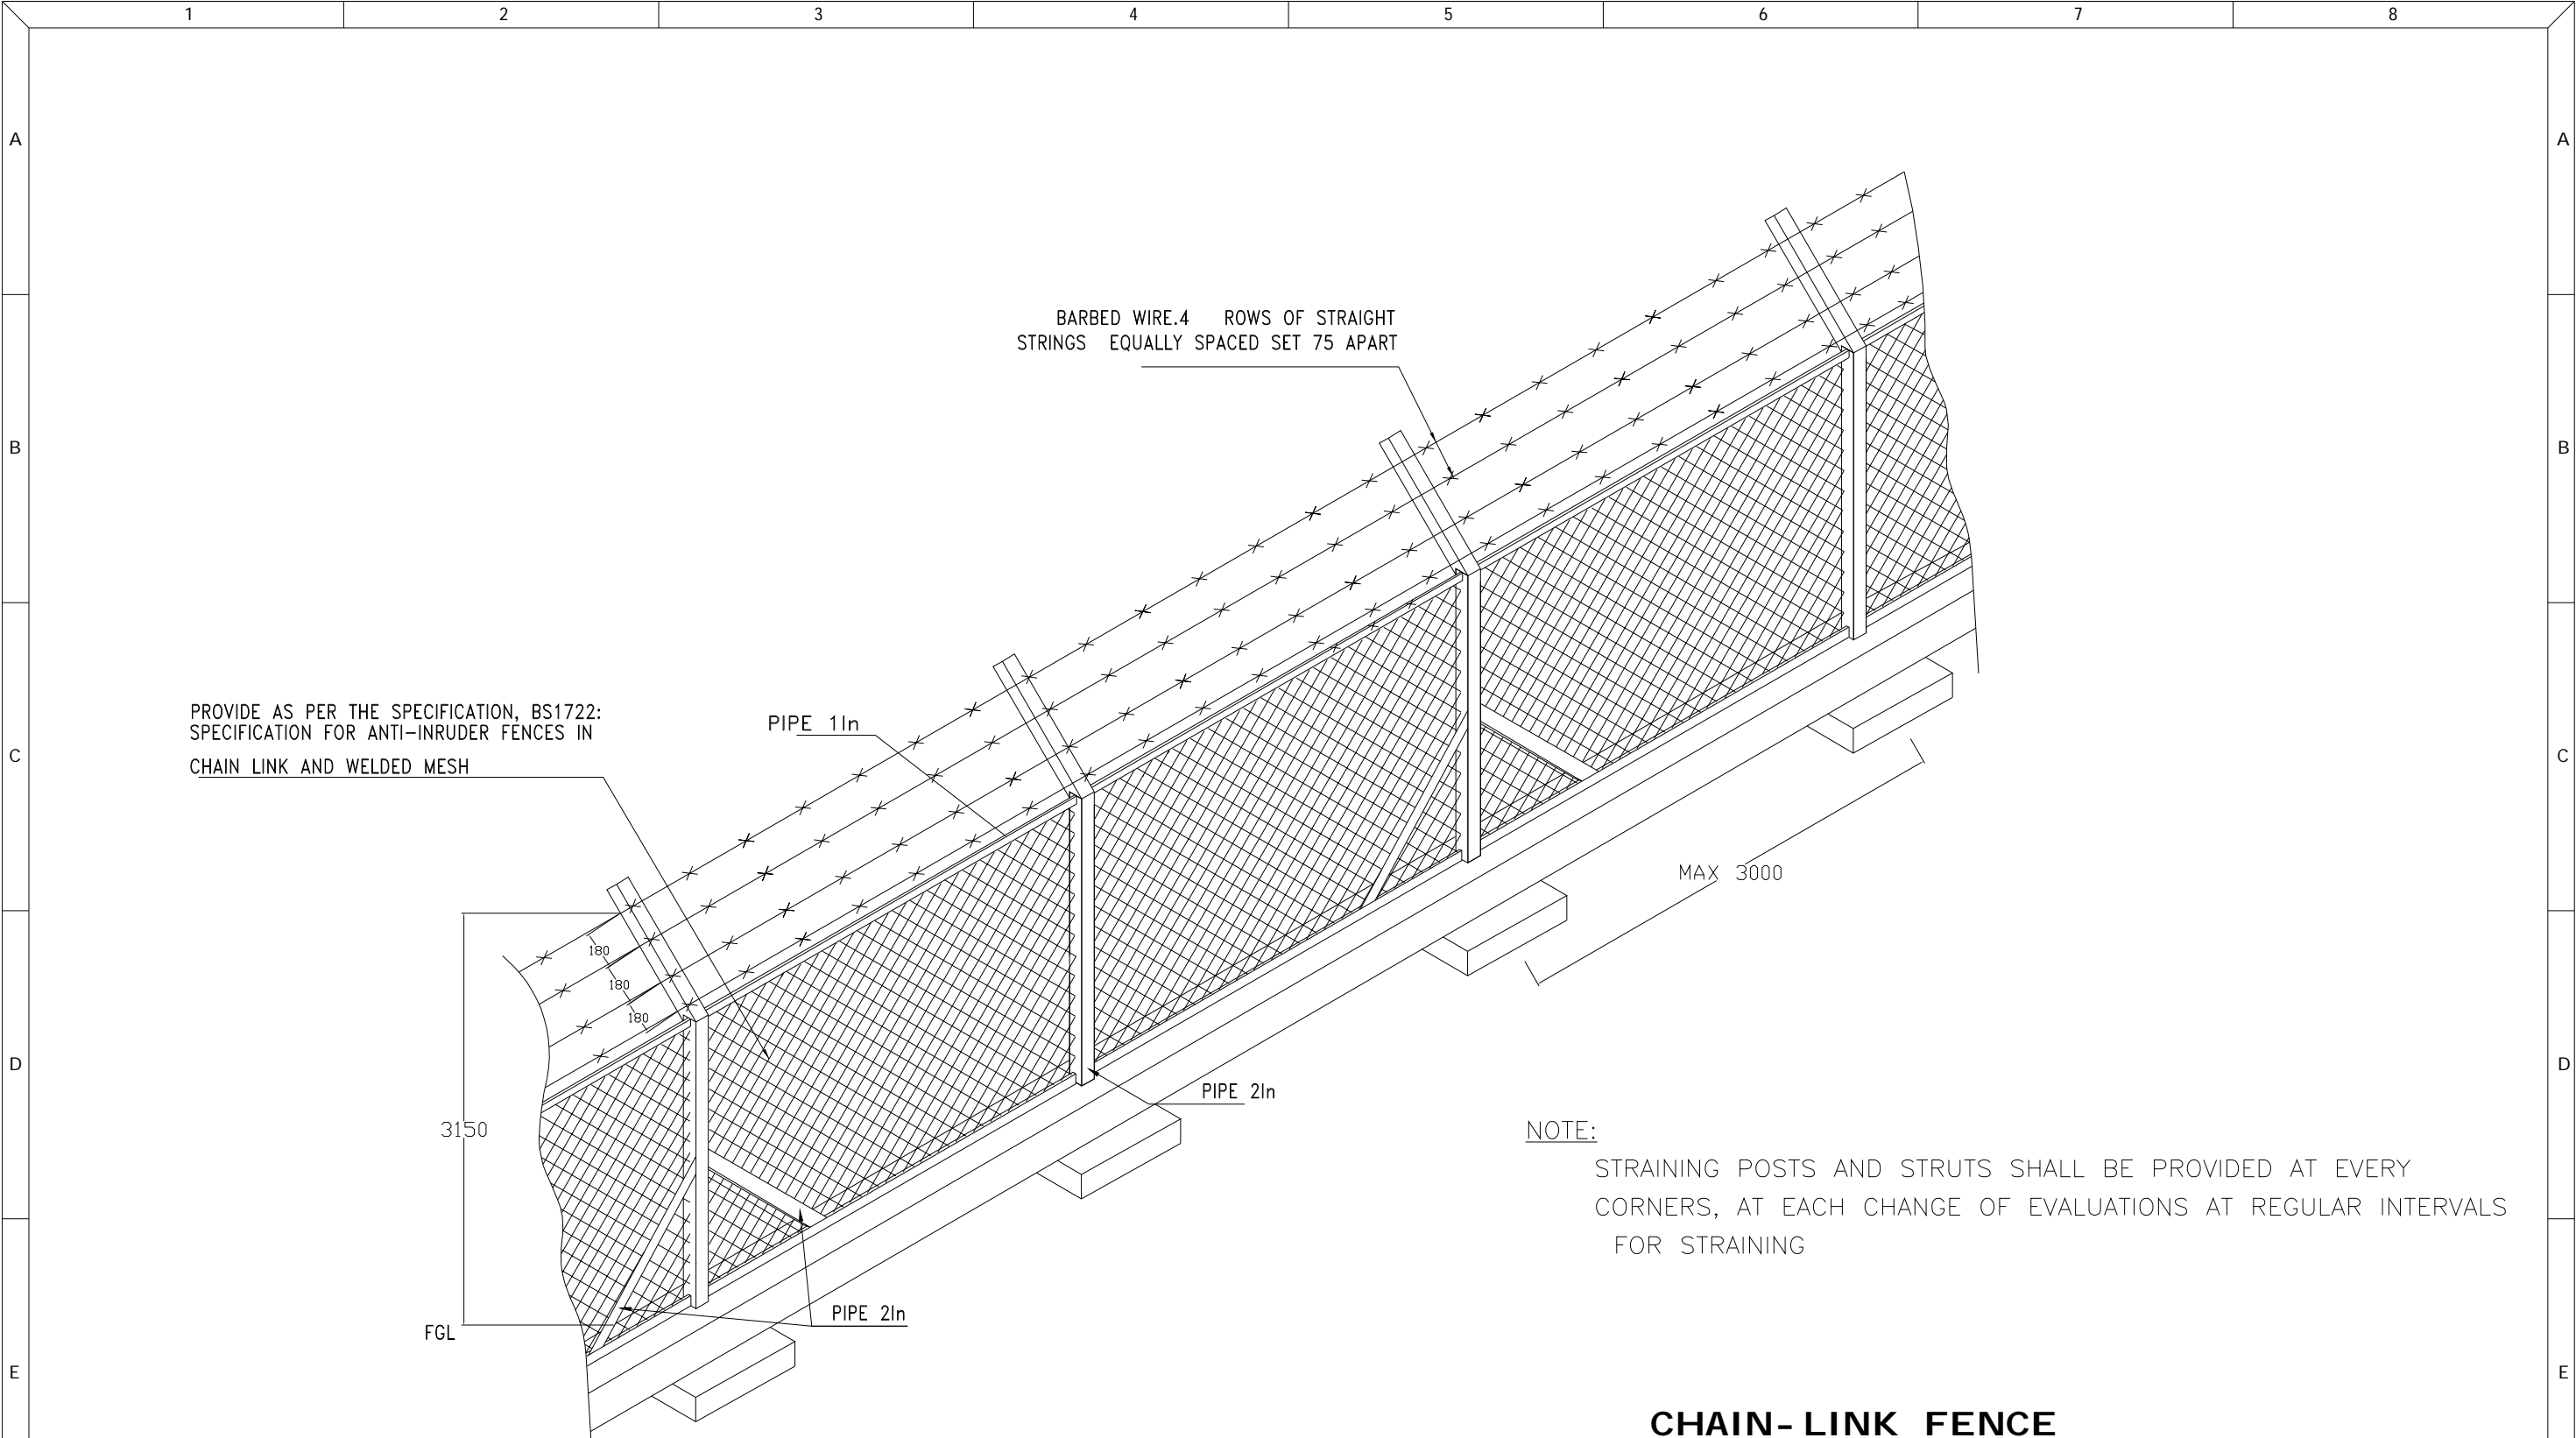DESIGNATION OF	TITLE	REVISION			
1	COVERING SHEET	0	A	B	
2	INDEX	0	A	B	
3	CHAIN LINK FENCE DRAWING	0	A	B	
4	ENTRANCE GATE DRAWING	0	A	B	





PREPARED BY:								DESIGNED BY		NVM		SIGNATURE		PROJECT:		DWG. TITLE:		CLIENT:							
<div>ف</div> <div>موننكو ايران Monenco Iran</div> <div>1</div>								DRAWN BY		SAT		<div>KIMUKA (400/220 kV Substation)</div> <div>5</div>		CHAIN LINK FENCE AND ENTRANCE GATE DRAWING		<div> KETRACO Kenya Electricity Transmission Co. Ltd.</div> <div> THE WORLD BANK IBRD IDA WORLD BANK GROUP</div> <div>8</div>									
		B						THIRD ISSUE		NVM								SAT		ARG		JVN		19.09.2021	
		A						SECOND ISSUE		NVM								SAT		ARG		JVN		30.05.2021	
		0						FIRST ISSUE		NVM								SAT		ARG		JVN		03.05.2021	
		REV						DESCRIPTION		DESIGN								CHK		HEAD		APPR.		DATE	
								CHECKED BY		ARG				DATE: 19.09.2021		DWG. NO.:MT-TLD-KETCO-5393-DD-01-WF-383		SHEET: 3 OF: 4							
								APPROVED BY		JVN															
								SCALE:																	

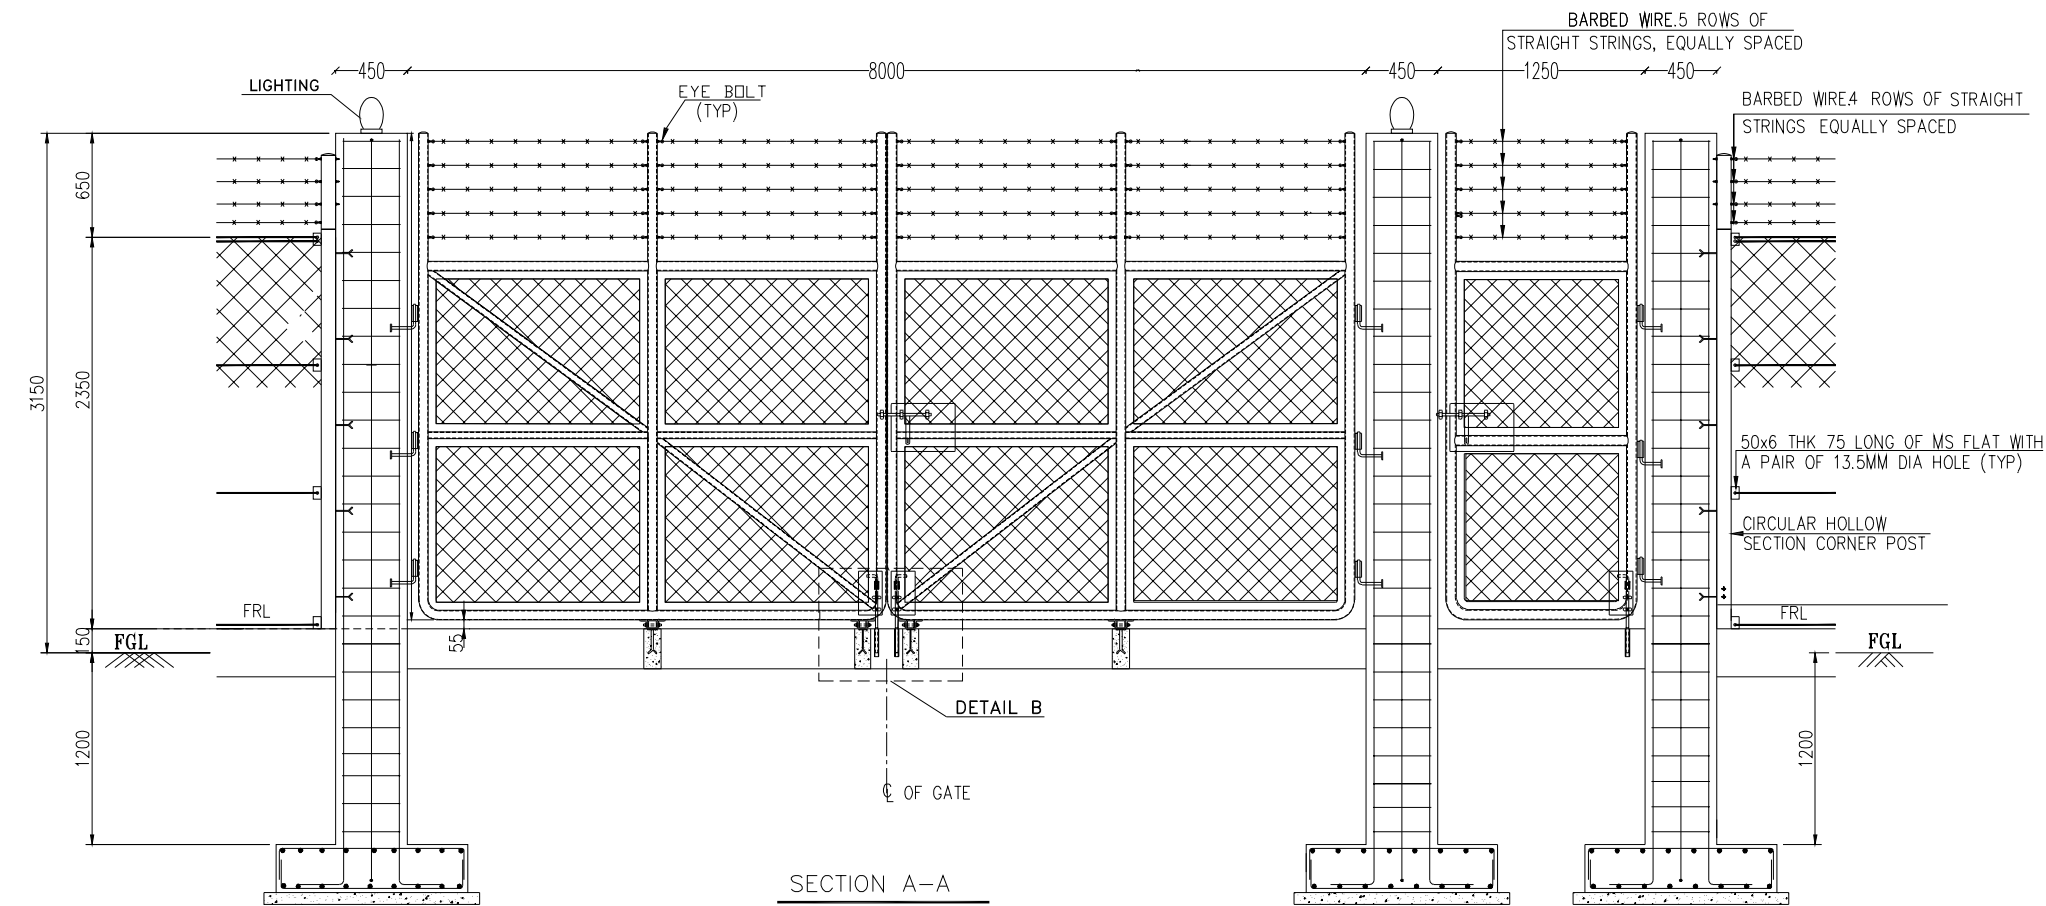

NOTE:

- 1-ALL DIMENSIONS ARE IN mm.
- 2-CONCRETE SHOULD HAVE MINIMUM COMPRESSIVE STRENGTH OF 250kg/cm² AFTER 28 DAYS ON CYLIND. SPECIMEN.
- 3-LEAN CONCRETE SHOULD HAVE AT LEAST 150kg CEMENT PER m³.
- 4-ALL REINFORCMENT SHOULD BE DEFORMED WITH BARS F_y=4000kg/cm².
- 5-FOR CONCRETE USE CEMENT TYPE I
- 6-ALL REINFORCMENT SHOULD HAVE min. 75mm COVERING OTHERWISE NOTED.
- 7- THE GATE COLOR SHALL BE ACCORDING TO KETRACO APPROVED COLOR CODE.
- 8- THE SWING GATE SHALL HAVE WHEELS.

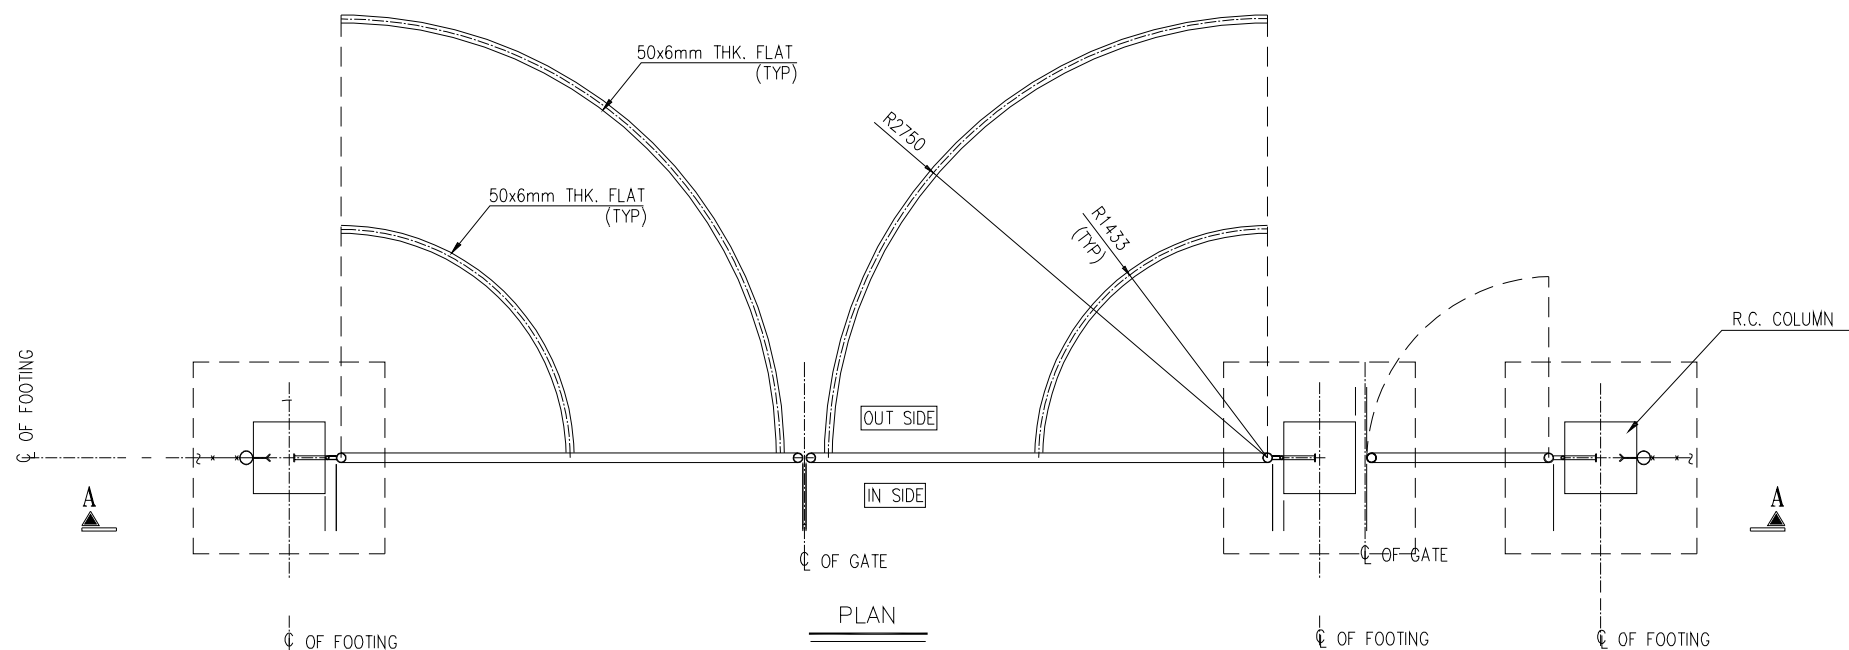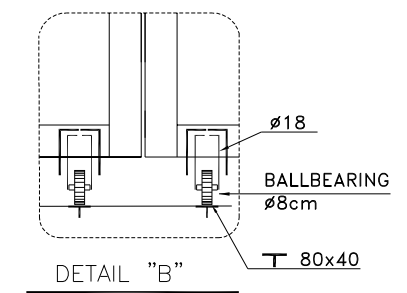




ENTRANCE GATE

LEGEND:

F.G.L=FINISHED GROUND LEVEL
F.R.L=FINISHED ROAD LEVEL

SECTION PROPERTIES:

ITEM	SIZE
SIDE AND TOP FRAME TUBES	100x50x4mm
BOTTOM TUBES	100x50x4mm
VERTICALS	25x25x2.5mm
INTERMEDIATES	100x50x4mm

<div>PREPARED BY:</div> <div>موننکو ایران Monenco Iran</div> <div></div>								DESIGNED BY	NVM	SIGNATURE	PROJECT: <div>KIMUKA (400/220 kV Substation)</div>	DWG. TITLE:		CLIENT: <div><div>KETRACO Kenya Electricity Transmission Co. Ltd.</div><div>THE WORLD BANK IBRD · IDA WORLD BANK GROUP</div></div>	
								DRAWN BY	SAT			CHAIN LINK FENCE AND ENTRANCE GATE DRAWING			
	B	THIRD ISSUE	NVM	SAT	ARG	JVN	19.09.2021	CHECKED BY	ARG						
	A	SECOND ISSUE	NVM	SAT	ARG	JVN	30.05.2021	APPROVED BY	JVN						
	0	FIRST ISSUE	NVM	SAT	ARG	JVN	03.05.2021	DATE: 19.09.2021		DWG. NO.:MT-TLD-KETCO-5393-DD-01-WF-383		SHEET: 4 OF: 4			
	REV	DESCRIPTION	DESIGN	CHK	HEAD	APPR.	DATE	SCALE:							
1	2	3			4			5			6		7		8