



CG Holdings Belgium NV

Systems Division

Antwerpsesteenweg 167, B-2800 Mechelen

Tel.: +32(0)15/283 33 Fax: +32(0)15/283 491

www.cgglobal.com

Client: **Republic of Kenya – Ministry of Energy**

Project Name: **Nanyuki - Isiolo - Meru
Electrification Project**

Contract Number: MOE-P4-2011


Document Title: **OHL 132kV DOUBLE TENSION SET
ASSEMBLY DRAWING**

Project Number: 100008
Document Number: 100008-L0-DG-CA01
Revision: 01

This document contains the following:

No.	Vendor Document number	Vendor Rev.	Description	Pages
1	11-1444-01	1	DOUBLE TENSION SET	1

01	21/05/2013	First issue	ARRUTI	NWLS	RCAV
Rev.	dd/mm/yyyy	Description	Created	Checked	Approved

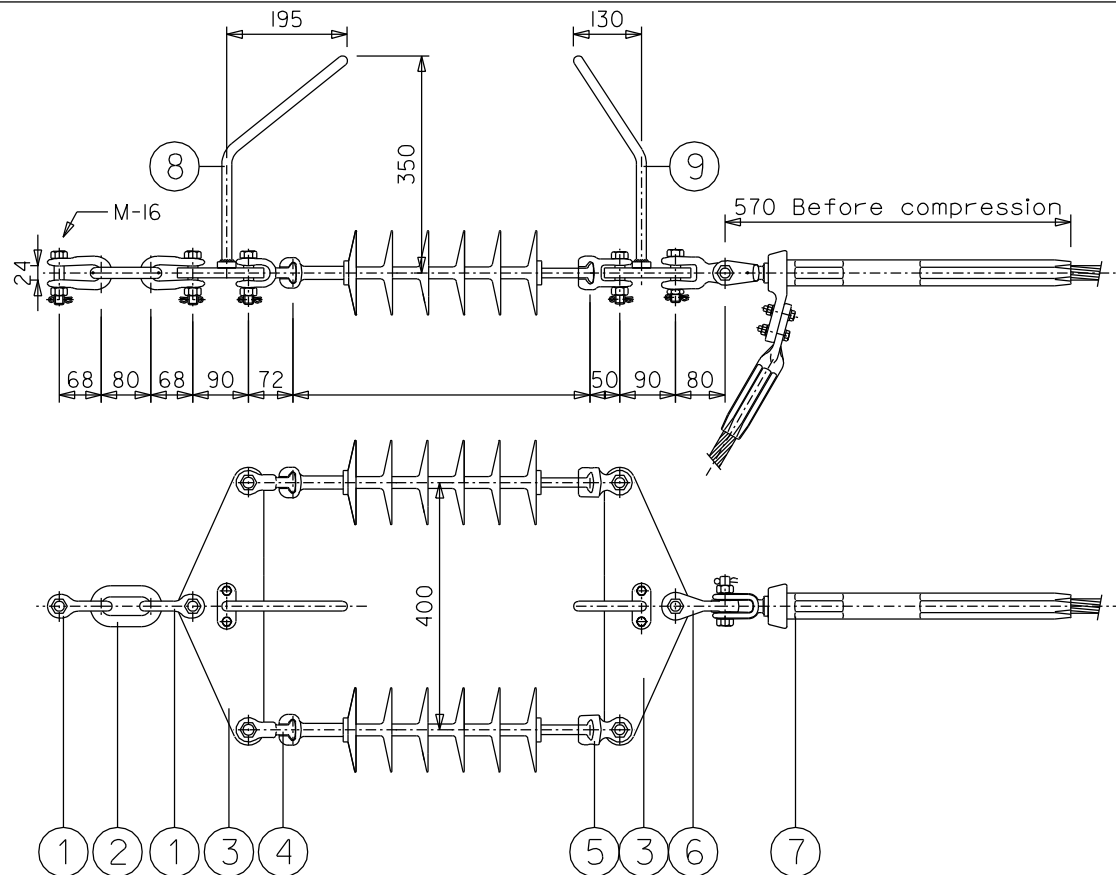

ARCHIVO:CCNXBB

9	1	ARCING HORN DI-35/I3	2202	STEEL	GALVANIZED	
8	1	ARCING HORN DI-35/I9	1405	STEEL	GALVANIZED	
7	1	COMPRESSION CLAMP CH-226	7816	ALUMINIUM-STEEL	GALVANIZED	
6	1	CLEVIS EYE HR-I6/2I	0063	STEEL	GALVANIZED	
5	2	CLEVIS SOCKET RH-I6	0057	STEEL	GALVANIZED	
4	2	CLEVIS BALL HBP-I6	0065	STEEL	GALVANIZED	
3	2	YOKE PLATE Y-I6/400-I4	3229	STEEL	GALVANIZED	
2	1	CHAIN LINK ES-I6/20	0896	STEEL	GALVANIZED	
1	2	STRAIGHT SHACKLE GN-I6T	0018	STEEL	GALVANIZED	
No	QTY	DESCRIPTION	CATALOGUE NUMBER	MATERIAL	FINISH	



INDUSTRIAS
ARRUTI S.A.

BALL/SOCKET STANDARD COUPLING I6, IEC-I20
MINIMUM BREAKING STRENGTH OF STRING: 12.500 daN
CLAMP BREAKING LOAD: 95% OF CONDUCTOR

DRAWN: X. ESPINOSA
SIGNATURE:

DO NOT SCALE

DOUBLE TENSION SET 132 KV
FOR ACSR LYNX CONDUCTOR
ASSEMBLY DRAWING

ISSUE	DATE
1	16-05-13
DRAW.	11-1444